

# HUALI GROUP



® Shenzhen Jinhuali Refrigeration Plant Co.,Ltd

Add:506 Rm,Block A2,Jinhai Building,JinHai Rd, XiXiang  
St,BaoAn District,ShenZhen,China.

Tel: 86-755-27914815

E-mail: hualiac@hualichina.cn

Dongguan Golden Refrigeration Equipment Co.,Ltd

Add:No.338, Yangxin Road, Yangchong Village, Dalang Town,  
Dongguan, Guangdong China.

Tel: 86-755-27914815


<http://www.hualichina.cn>

## Spilt Fan Coil Unit

| 型号 Model HLC~              |                            | 51G                      | 68G             | 85G             | 102G  |
|----------------------------|----------------------------|--------------------------|-----------------|-----------------|-------|
| 风量 Air flow m3/h           |                            | 510                      | 680             | 850             | 1020  |
| 制冷量 Cooling capacity       | W                          | 2800                     | 3700            | 4700            | 5600  |
|                            | BTU                        | 9556                     | 12628           | 16041           | 19113 |
| 制热量 Heating capacity       | W                          | 4190                     | 5490            | 6930            | 8220  |
|                            | BTU                        | 14300                    | 18737           | 23652           | 28055 |
| 水流量 Water flow kg/h        |                            | 600                      | 770             | 960             | 1190  |
| 功率 Input Power W           |                            | 52                       | 62              | 76              | 96    |
| 噪音 Noise level dB (A)      |                            | 39                       | 41              | 43              | 45    |
| 出口静压 Pressure of outlet    |                            | 12Pa                     |                 |                 |       |
| 电源 Power                   |                            | 220V/1ph/50HZ            |                 |                 |       |
| 绝缘等级 Insulated grade       |                            | E                        |                 |                 |       |
| 翅片类型 Heating discharge fin |                            | Vertical blinds style    |                 |                 |       |
| WA                         | 电机数量 Quantity of the Motor | 1                        |                 |                 |       |
| WM                         | 风轮数量 Quantity of the Fan   | 1                        |                 |                 |       |
| LA                         | 进水管 Water inlet pipe       | DN20 内螺纹 internal thread |                 |                 |       |
| LM                         | 出水管 Water outlet pipe      | DN20 内螺纹 internal thread |                 |                 |       |
| 冷凝管 Condenser pipe         |                            | DN20 内螺纹 internal thread |                 |                 |       |
| Size(mm)                   |                            | A850*B290*C180           | A1030*B290*C180 | A1080*B330*C215 |       |

备注：进出口水管、冷凝管均为DN20

Remark: it is DN20 for both inlet/outlet water pipes and Condenser pipe.

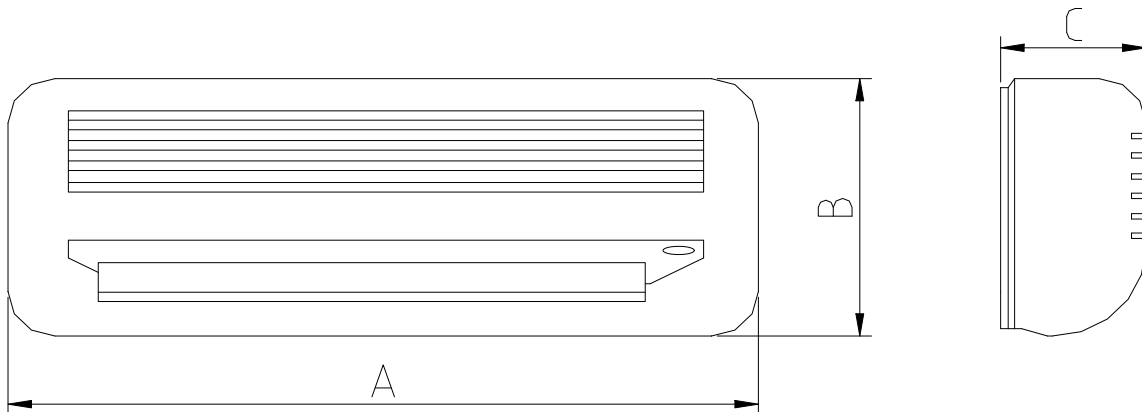

# HUALI GROUP



® Shenzhen Jinhuali Refrigeration Plant Co.,Ltd

Add:506 Rm,Block A2,Jinhai Building,JinHai Rd, XiXiang St,BaoAn District,ShenZhen,China.

Tel: 86-755-27914815

E-mail: hualiac@hualichina.cn

Dongguan Golden Refrigeration Equipment Co.,Ltd

Add:No.338, Yangxin Road, Yangchong Village, Dalang Town, Dongguan, Guangdong China.

Tel: 86-755-27914815

<http://www.hualichina.cn>

## HLC-51&68G Reference Pictures

